

YCB7LE-63 series


RESIDUAL CURRENT OPERATED
CIRCUIT BREAKER

OPERATION INSTRUCTION

Standard: IEC 61009-1

CNC

Deliver
Power For Better Life

 Before installing and using this product,
please read this manual carefully and
pay more attention to safety.

YCB7LE-63 series

Residual Current Operated Circuit Breaker Instruction

1 General

YCB7LE-63 residual current operated circuit breaker with over-current protection (hereinafter referred to as RCBO) is suitable for AC 50Hz/60Hz, rated voltage up to 400V, rated current up to 63A, for residual current protection, overload and short circuit protection. When the human body gets an electric shock or the network leak current exceeds the specified value, the residual current operated circuit breaker can rapidly cutoff the human body and the powered equipment. With the function of overload and short circuit protection, the residual current operated circuit breaker can be used to protect the circuit or motor from being damaged by overload and short circuit, and can also be used for not-frequent operational transformation in the circuit under normal condition.

The product meets the standards of IEC 61009-1.

2 Operating conditions


2.1 Ambient temperature: $-25^{\circ}\text{C} \sim +60^{\circ}\text{C}$.

- 2.2 Air conditions: At mounting site, relative humidity not exceed 50% at the maximum temperature of +40°C. For the wettest month, the maximum relative humidity averaged shall be 90% while the lowest temperature averaged in that month is +20 , special measures should be taken to occurrence of condensation.
- 2.3 Altitude: ≤2000m.
- 2.4 The installation category is II and III.
- 2.5 The circuit breaker shall be installed on DIN rail EN 60715(35mm), which shall meet the A1.1TH 35-7.5 steel mounting rail requirements.
- 2.6 Pollution grade: 2
- 2.7 Mounting conditions: inclination between mounting plane and vertical plane not exceed ±5°
- 2.8 The external magnetic field of the installation site should not exceed 5 times of the geomagnetic field in any direction.
- 2.9 The product should locate in the places where there are no obvious impact and shake.

3 Basic parameters

3.1 Type designation

YC B 7 LE - 63



3.2 The basic specifications and technical parameters of the circuit breaker are shown in Table 1, and breaking time of the residual current operating is shown in Table 2.

Table 1

Poles	Rated residual operating current $I_{\Delta n}$	Frequency Hz	Rated voltage U_e/V	Rated current I_n/A	Tripping type	Rated residual Making and Breaking capacity $I_{\Delta m}$	Rated short circuit capacity I_{cn}
1P+N:1 pole 2 wires	0.03A /0.05A /0.1A /0.3A $I_{\Delta no} = 0.5I_{\Delta n}$	50/60	AC230	60,10, 16,20, 25,32, 40,50, 63	B type: (3~5) I_n C type: (5~10) I_n D type: (10~20) I_n	500 ($I_n \leq 40A$); 630 ($I_n > 40A$)	4.5kA
2P: 2 poles			AC230				
3P: 3 poles			AC400				
3P+N:3 pole 4 wires			AC400				
4P: 4 poles			AC400				

Table 2

In(A)	IΔn(A)	Breaking time when the residual current is the following values (s)				
		IΔn	2IΔn	5IΔn a	5A~200A 500A b	IΔt c
6~63	0.03/ 0.05/ 0.1/0.3	0.1	0.05	0.04	0.04	0.04

a. For general RCBO with $I\Delta n \leq 0.03A$, 0.25A can be used instead of $5I\Delta n$.

b. The test of 5A ~ 200A, 500A is only performed for the verification of operation, and is not performed for the magnitude of current greater than the lower limit of the over-current instantaneous tripping range.

c. The test is carried out for the current with the $I\Delta n$ being equal to the lower limit of the over-current instantaneous tripping range for Type B ,Type C or Type D.

3.3 Over-current protection characteristic is shown in Table 3.

Table 3

Test	Type	Testing current	Initial state	Time limit for tripping or not tripping	Expected result	Testing environment temperature	Remarks
a	B/ C/D	1.13In	Cold state	$t \leq 1h$ ($In \leq 63A$)	Not tripping	30 °C~35 °C	Current is rising within 5s
	B/ C/D	1.45In	Right after test a	$t < 1h$ ($In \leq 63A$)	Tripping		
c	B/ C/D	2.55In	Cold state	$1s < t < 60s$ ($In \leq 32A$) $1s < t < 120s$ ($In > 32A$)	Tripping		
	B C D	3In 5In 10In	Cold state	$t \leq 0.1s$	Not tripping		
e	B C D	5In 10In 20In	Cold state	$t < 0.1s$	Tripping		

Note: The terminology "Cold state" means that the test is performed at the base calibration temperature with no load prior to the test.

3.4 Mechanical and electrical life is show in Table 4

Table 4

Item	Times	Operating frequency (times/hour)	Power factor
Electrical life	4000	240 times per hour($I_n \leq 25A$)	Cos $\Phi=0.85\sim 0.9$
Mechanical life	10000	120 times per hour($I_n > 25A$)	

3.5 Wiring

Before installation, check whether technical parameter of the circuit breaker is in conformity with user's requirement.

The conductor of power supply shall be connected to the up terminal of circuit breaker. During installation, the tightening torque is max $2.5N \cdot m$.

The sectional area of connecting wire can refer to Table 5.

Table 5

Rated Current $I_n(A)$	Conductor cross-sectional area $S(mm^2)$
6	1
10	1.5
16、20	2.5
25	4
32	6
40、50	10
63	16

4 Overall and mounting dimensions(mm)

3.5 Wiring

Overall and mounting dimensions of the circuit breaker are shown in Fig.1 and Table 6.

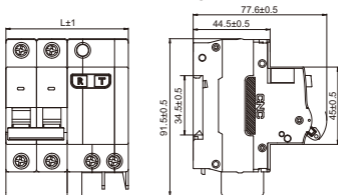


Table 6

Number of current loops	Number of poles	Size L
Single pole two wire	1P+N	53.3
Two poles	2P	71.1
Three poles	3P	101.9
Three poles four wire	3P+N	114.9
Four poles	4P	132.7

5 Ordering instructions

5.1 When ordering, the customer shall indicate:
the product name of RCBO, model, rated
current, rated residual operating current,
instantaneous tripping type, number of poles,
quantity.

For example: YCB7LE-63 C 63 1P+N 0.03A
880units.

5.2 Special requirements of customers can be
negotiated separately.



CERTIFICATE

Product Model: YCB7LE-63

Standard: IEC 61009-1

Inspector : **CNC003**

Production date: Printed on the product
or package.

This product is qualified according
to the delivery inspection

A red rectangular box containing the white text 'CNC' in a bold, sans-serif font.

YCB7LE-63 series

CNC ELECTRIC

Tel: 0086-577-61989999 Fax: 0086-577-61891122

www.cncele.com E-mail: cncele@cncele.com